

Aotoro®

EK75 自由电源带延时器型

Free Power type with timer

INSTRUCTION MANUAL 使用说明书

PHOTOELECTRIC SENSOR
光电开关

CE




A2302-10

Ordering information 订购信息


EK75-DS70M4

Output 输出状态	1	Light ON 入光ON
	2	Dark ON 遮光ON
	4	Selectable Light ON or Dark ON by control wire (可通过控制线选择入光ON或遮光ON)
Output 输出构成	C	DC NPN output
	B	DC PNP output
	M	Free power relay output 自由电源触点输出型
Detecting distance 检测距离	D	DC power relay output 直流电源触点输出型
	A	AC power relay output 交流电源触点输出型
	Z	AC 2-wire 交流电源二线控制型
Detecting type 传感方法	70	70cm
	4	4m
	10	10m
Serial number 设计序号	DS	Diffuse reflective 直接反射
	R	Retroreflective 反射板反射
	T	Through-beam 对射
Photoelectric switch 光电开关	75	Side lenght of head 探测头边长
	EK	Relay contact output触点输出型
	ER	Cylindrical type 圆柱型
	ED	DC universal type 通用型
	EU	Groove shape type槽型

Specification 规格

Model 型号	Diffuse reflective type 直接反射型	Retroreflective type 反射板反射型	Through-beam type 对射型
			
Free power 自由电源	EK75-DS70M4	EK75-R4M4	EK75-10M4
Detecting distance 探测距离	0~70cm	0~4m	0~10m
Detecting target 探测物体	—	Opaque materials of Min. φ 60mm 直径60mm以上不透明体	Opaque materials of Min. φ 15mm 直径15mm以上不透明体
Hysteresis 回差	Max. 20% at detecting distance 不大于检测距离的20%	—	—
Power Supply 电源电压	Free power 自由电源 AC24~240V/DC24~240V		
Power consumption 静态功率	Max.3VA		
Response time 响应时间	Max.20ms		
Control output 控制输出	Relay contact output 250VAC3A of resistive load: Relay contact composition 1c		
Timer function 定时器功能	Selectable ON Delay, OFF Delay, ALL Delay by switch, Delay time 延时时间: 0.1 to 5 sec 秒 (VR adjustable)		
Operation mode 操作模式	Selectable Light ON or Dark ON by switch 可通过开关选择 入光-ON或遮光-ON		
Insulation resistance 绝缘	Min.20MΩ(500VDC)		
Dielectric strength 耐电压	1500VAC 50/60HZ for 1 minute		
Ambient illumination 使用环境照度	Sunlight 太阳光: Max. 10000lx, Incandescent lamp 日光灯: Max. 3000lx		
Operating temperature 使用环境温度	-20 to 60°C (non-freezing condition 不结冰)		
Ambient humidity 使用环境湿度	35 to 85% RH		
Protection 保护结构	IP64		
Material 材质	Case外壳: ABS, Lens镜头: PC		
Connection 连接方式	Outgoing cable 端子连接		
Accessory 附件	Bracket 托架, Bolts/nuts 螺栓/螺母, Cable: φ 6mm, 5p, 2m 配线		


Connections 连接图

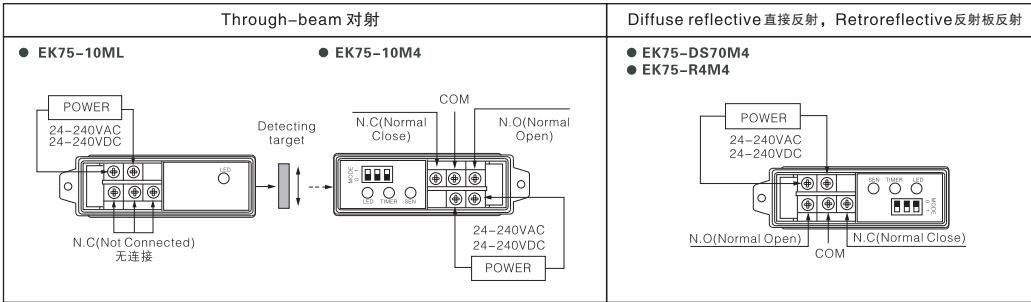

Operation mode 操作图解

开关各部的说明	开关的选定方法		Timing时间段				
Normal mode 基本动作型	<p>MODE 0 → D-ON L-ON D-ON Operation switch 转换开关</p> <p>L-ON L-ON ← 光继电器ON D-ON D-ON ← 遮光继电器ON</p>		<p>Received light 入光 Interrupted light 遮光 L-ON [ON OFF] ON D-ON [ON OFF] OFF</p>				
Timer mode 延时器型	<p>MODE 0 → 1 L-ON D-ON SW1 SW2 TIMER Operation switch 动作模式转换开关 Timer switch 定时器模式转换开关</p>	ON延时Delay	OFF延时Delay	ALL延时 Delay	ON延时Delay	OFF延时Delay	ALL延时 Delay
	<p>仅SW1为(1) 仅SW2为(1) SW1,SW2都为(1)</p>	<p>仅SW1为(1) 仅SW2为(1)</p>	<p>SW1,SW2都为(1)</p>	<p>入光时 遮光时 L.ON ON D.ON OFF</p>	<p>入光时 遮光时 L.ON OFF D.ON ON</p>	<p>入光时 遮光时 L.ON ON D.ON OFF</p>	

Dimensions 尺寸(unit:mm)

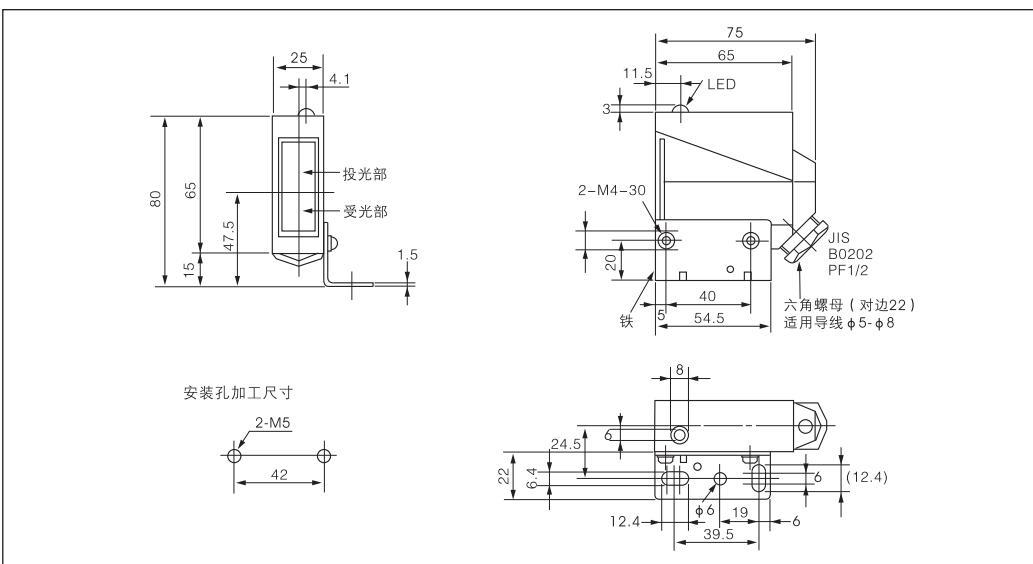


Installation and sensitivity adjustment 安装及感光度调节

Please supply the power to the sensor after installing the emitter and the receiver in face to face, and then adjust an optical axis and the sensitivity as follow:

● Diffuse reflective type 直接反射型

- Even though the diffuse reflective type is set at max. sensitive position. The sensitivity of the sensor must be adjusted in accordance with the existence of the reflective material in background.
- 即使是直接反射型也要进行最大感光度的设置。传感器感光度的调节必须和反射材料的背景保持一致

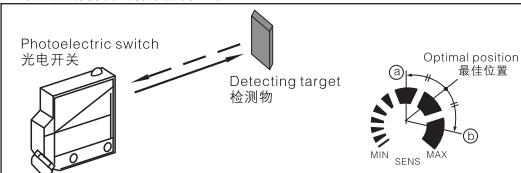

- Set the target at the area of the detecting, then turn the adjuster down to point① where the indicator just turns on from Min. position of the adjuster. 安装检测物到可检测区域，调节旋纽从最小位开始调节，当调节到指示灯刚好亮时，此时的旋纽位置为①点。
 - Take the target out of the sensing area, then turn the adjuster until point② where the indicator turns on. If the indicator does not turn on, max. Position is point③. 从感应区域拿开检测物，调节到指示灯亮时，此时的旋纽位置为②。如果指示灯一直不亮，那么旋纽的最大位置就是③的位置。
 - Set the adjuster at the center of two switching point ④,⑤. ④⑤两点中间位置就是最佳位。
- * The detecting distance indicated in the specification chart is that of non-glossy white paper in the target size 100×100mm.

* 检测物是规定的100×100mm的白色无光泽纸

● Retroreflective反射板反射

- Supply the power to the photoelectric sensor, after setting the photoelectric sensor and the mirror(TD-08)in face to face. 将发生器和反射板镜面面对面安装，并调节光轴位置和灵敏度后连接电源。
- Set the photoelectric sensor in the position which indicator turns on, as adjusting the mirror or the sensor right and left, up and down. 调节反射板上下左右位置，使传感器的指示灯变亮后固定

Precautions in using the product 使用注意事项

NOTE 注意


Be sure to follow the safety precautions below for adder safety

以下项目在安全确保方面非常重要的，请务必遵守。

- Do not use the sensor under the explosive or flammable gas environment. 请不要在具有可燃性、爆炸性气体的环境下使用。
- Never disassemble, repair or tamper the product. 请勿拆卸、修理、改造本产品。
- Keep the supply voltage within the specified area. 电源电压必须在额定值内。
- use the load under the specified area. 请使用额定值以下的负载。

Caution for using 正确使用方法

- Do not use the product under the following conditions. 请不要在以下的环境中使用。
 - In the place of the direct sunlight. 日光直射场所。
 - In the place where humidity is high and condensation may occur. 湿度高或易结露场所。
 - In the place of the corrosive gas exists. 含腐蚀性气体场所。
 - In the place where vibration or shock is directly transmitted to the product. 振动或冲击能直接传送到传感器场所。
- Connection and Mounting 连接和安装
 - Be sure that before giving the power, the supply voltage is less than the maximum rated supply voltage. 通电前请确认供电电源电压小于最大允许电源电压。
 - There are some cases where the photoelectric switch cable is unavoidably laid in a tube or duct together with a hightension or power line. This causes an induction, possibly resulting in malfunction or damage. In principle, the cable should be separately laid or shielded. 传感器导线和动力线或电力线装在同一配管中使用时，会受到干扰，有误动作甚至被损坏。原则上传感器导线必须单独放置或者被屏蔽。

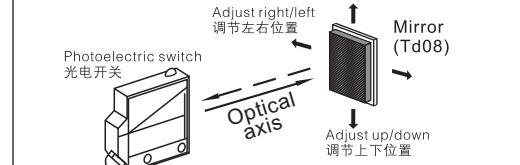


3. Fix both units tightly after checking that the unit detects the target.

- * If use more than 2 photoelectric sensors in parallel, the spase between them should be more than 30cm.
如果并行同时使用2个以上光电传感器，那么它们的间距应大于30cm
* If reflectance of target is higher than non-glossy white paper, it might cause malfunction by reflection from the target when the target is near to photoelectric sensor. Therefore put enough space between the target and photoelectric sensor or the surface of target should be installed at an angle of 30 to 45 against optical axis. 如果被检测物体的反射率比反射板镜面的高，它会发生误动作。因此在传感器和被测物体之间要有足够的空间，或者把被测物体和光轴成30-45°的角度

* Sensitivity adjustment: Please see the diffuse reflective type.
灵敏度调节时请参照直接反射型

● Through-Beam type 对射型

- Supply the power to the photoelectric sensor, after installing the emitter and the receiver face to face. 面对面的安装好发射器及接收器后请给传感器提供电源
- Set the receiver in center of position where indicator turns on, when adjusting the receiver and the emitter right and left, up and down. 调整接收器和发射器的上下左右位置，在指示灯亮时，在中心位置安装好接收器
- Fix both units tightly after checking that the units detect the target. 检查检测目标后安装牢固传感器

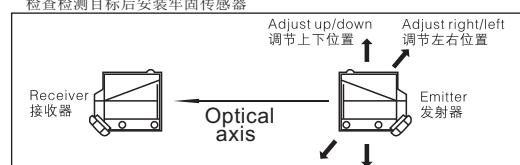

(3)For extending wires, whose cross section is greater than 0.3sqmm and the length less than 100m. 延长导线必须使用截面积0.3mm²以上、长度100m以下导线。

(4)Do not pull wire strongly. 导线请勿用力拉扯。

(5)Excessive force (hitting by hammer, etc.) Should not be put on the sensors because it may damage its water-resistance. 安装传感器时，请勿使传感器受剧烈外力（如用锤击打等），这样就有可能破坏传感器耐水保护性能。

3.Power supply 电源
When using a commercially available switching regulator ,be sure to ground the FG(Frame Ground) terminals.
使用市场上销售的开关整流器时，请将FG（Frame Ground）端子接地。

- Power supply reset time 电源重新调整时间
The photoelectric switch will begin sensing no later than 100ms after the power is turned on. If the load and the photoelectric switch connected to different power supply, the photoelectric switch must be always turned on first. 从接通电源到传感器可正常进行检出的时间是100ms后再使用。负载和传感器接不同电源时，一定要先接通传感器的电源
- Turning off the power supply 电源关闭
When turning off the power, output pulse may be generated. We recommend turning off the power supply of the load or load line first. 电源关闭时，可能会出现输出脉冲，所以我们建议先关闭负载或负载线的电源

浙江欧迪龙电子科技有限公司

Zhejiang Aotoro Electronic Technology CO.,LTD

ADD:Liu Huang Road 2188#, Liu Shui town, Yueqing city,Zhejiang province . PRC 325604
浙江省乐清市柳市镇柳黄路2188号

TEL:86-577-61758688 FAX:86-577-62757002
Http://www.aotoro.com E-mail:aotoro@aotoro.com